


Certificate of Analysis


KLOW 80 mg

Report To:
Koalaty Research

Compound: KLOW
Quantity: 80 mg
Laboratory ID: V260825-47 010
Lot Number: One (Sample 10)
Date Reported: 9/7/2026

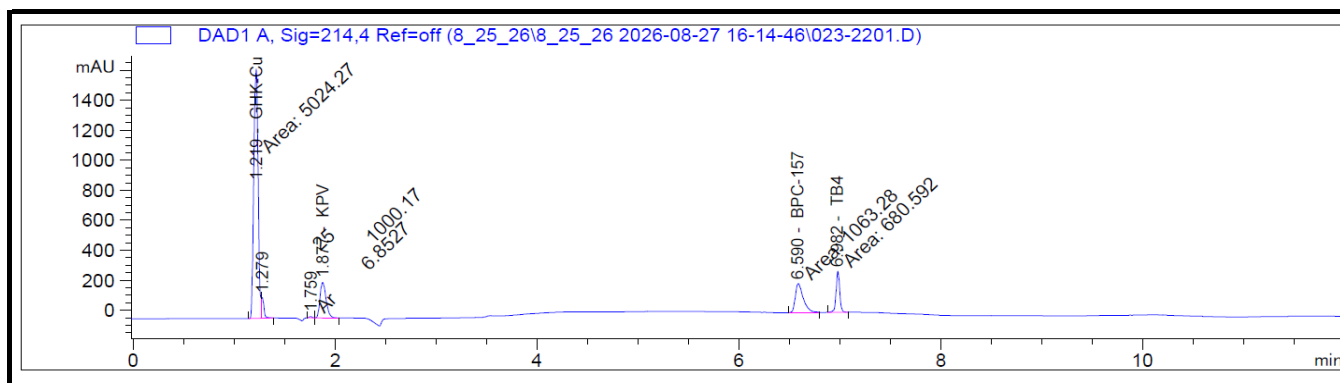

Analysis	Method	Result
Identity	HPLC-UV/VIS	Pass - Matches Ref. Standard
Chromatographic Purity	HPLC-UV/VIS	>99.50% $\pm$ 0.18%
Quantity: GHK-Cu	HPLC-UV/VIS	51.16 mg
Quantity: BPC-157	HPLC-UV/VIS	11.18 mg
Quantity: TB-500	HPLC-UV/VIS	10.73 mg
Quantity: KP	HPLC-UV/VIS	12.63 mg

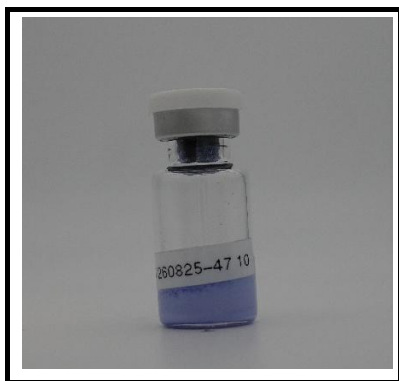

[Signature]

Report By: Dustin Newman, Laboratory Director on 9/7/2026

[Signature]

Approved By: Tori Johnson, Operations Manager on 9/7/2026

Please consult A2LA Certificate #6377.01.01 for a list of accredited tests. Samples were received in acceptable condition. The result(s) in this report relate only to the portion of the sample(s) tested. All analyses were performed consistent with the Vanguard Laboratory Quality Management System. Vanguard Laboratory and its staff did not observe or participate in the sample selection process, and cannot confirm the authenticity of the sample or its representativeness of the associated lot/batch. Blend purity is the combined chromatographic area % of peaks identified as the intended components, not absolute mass purity. It does not establish individual component purity, quantity, or ratio. Co-eluting or otherwise undetected impurities may not be included, despite peak-purity and spectral-library review.